



NOTES:

1. MINIMUM OF ONE 4-INCH ADJUSTMENT RING WITH A MAXIMUM OF 16 INCHES OF ADJUSTMENT.
2. PLACE CONCRETE AROUND OUTSIDE OF ADJUSTMENT RINGS AND RING TO PREVENT INFILTRATION/EXFILTRATION.
3. PRECAST CONE SECTION MAY BE CONCENTRIC OR ECCENTRIC.
4. GROUT SEAL PVC PIPE WHERE THE PIPE PENETRATES THE DRYWELL.
5. DRYWELLS NOT IN SIDEWALK SHALL BE PLACED IN A 6-FT. BY 6-FT. BY 6-IN. CONCRETE PAD AT FINISH GRADE.
6. STORM PIPE SHALL BE A MINIMUM OF 18 FEET IN LENGTH.
7. "STORM" SHALL BE CAST IN THE LID AND FRAME AND GRATE SHALL COMPLY WITH SEC. 9-05.15(1) OF THE COMMUNITY STREET AND UTILITY CONSTRUCTION STANDARDS.
8. ALL CONSTRUCTION AND MATERIALS SHALL MEET THE SPECIFICATIONS AND BE APPROVED BY THE CITY OF EPHRATA.

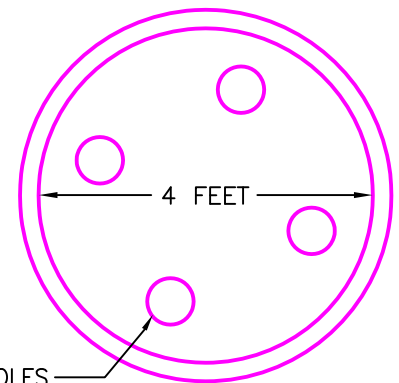

PRECAST BASE DETAIL

DATE	REVISION	BY
48-INCH PRECAST CONCRETE DRYWELL		
EPHRATA PUBLIC WORKS DEPARTMENT		
CITY OF EPHRATA		
DRAWN		
CHECK		
SCALE		
DATE		
10/03/08	GRANT COUNTY	WASHINGTON